
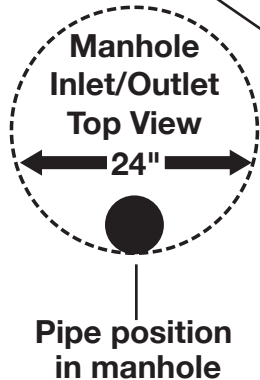


ReWa Grease Interceptor Detail

QUESTIONS? CALL: Kim McDonald – ReWa / 864-419-7251 or Keith Moore – ReWa / 864-419-7051

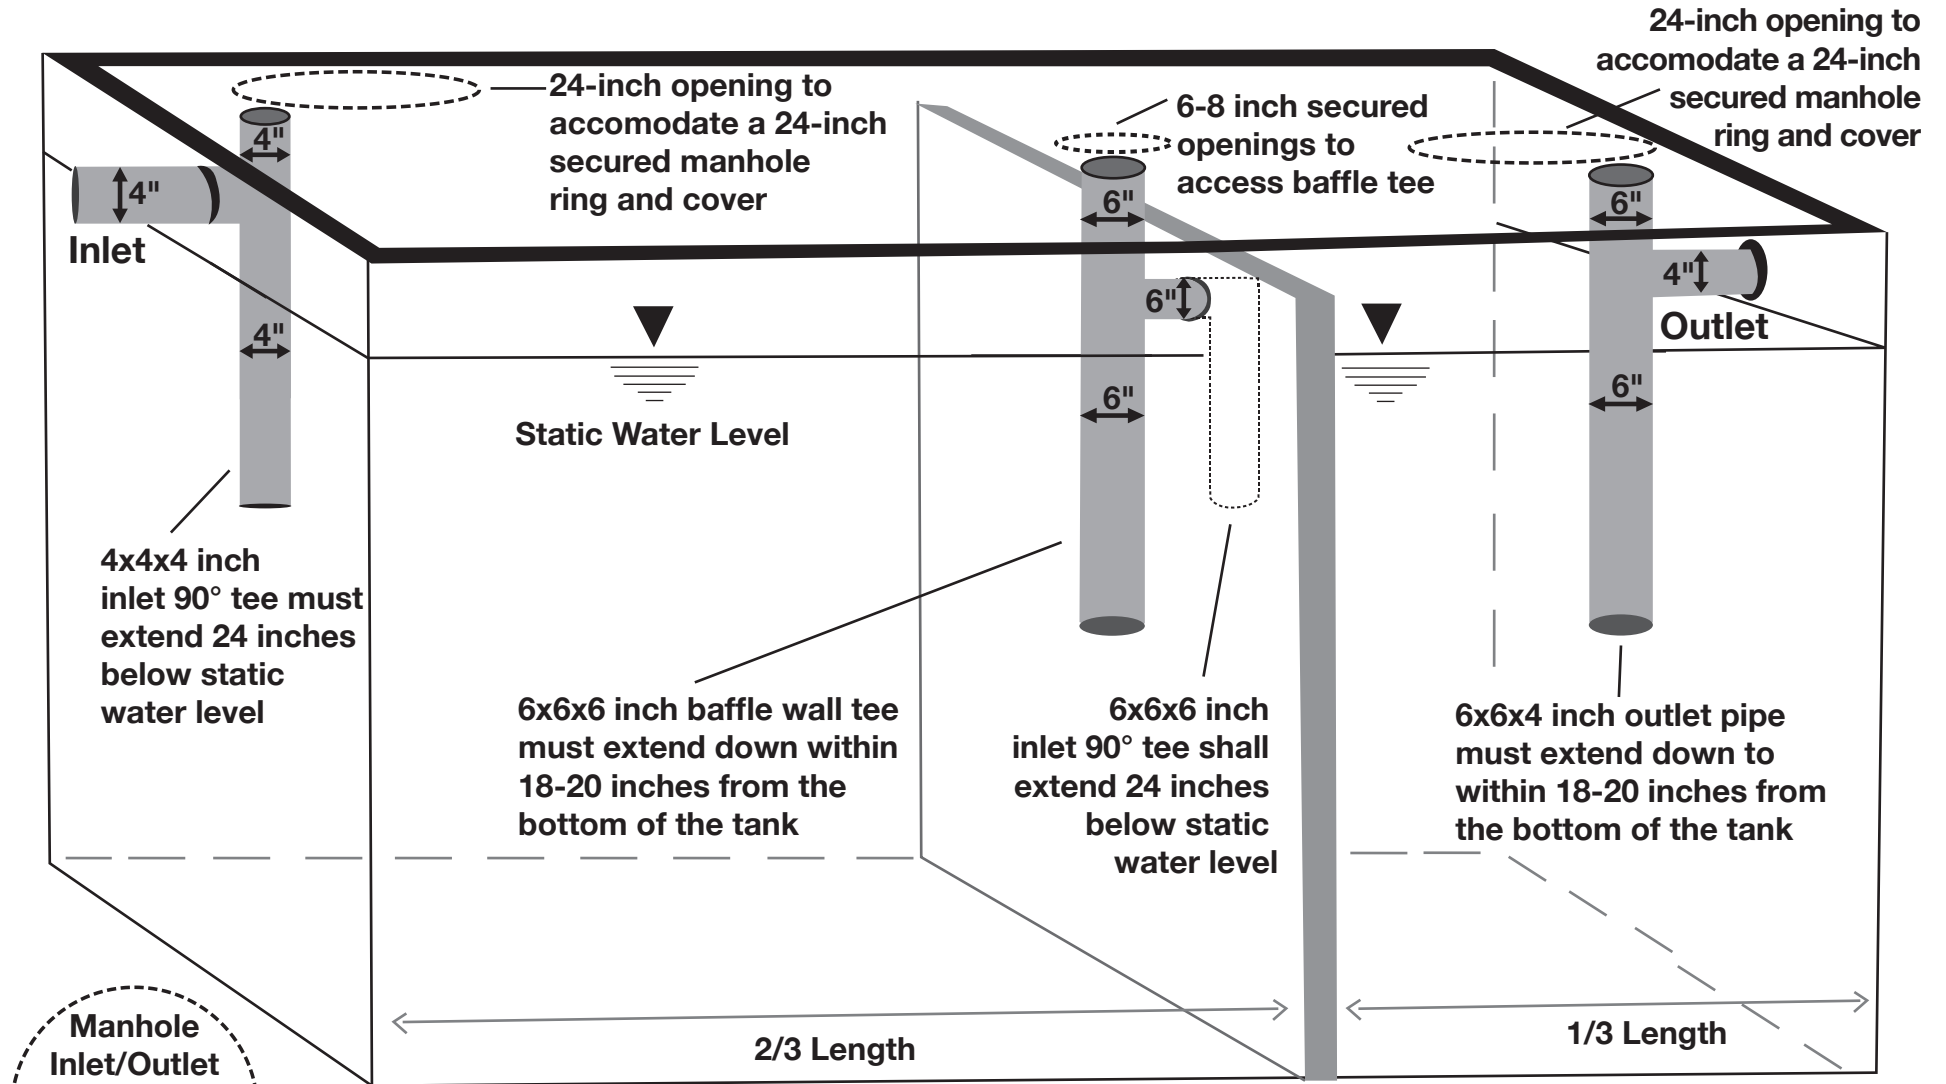

- All tees throughout tank must be DWV PVC 90 degree straight tees.
- All piping inside the grease interceptor must be PVC Schedule 40.
- Procedures or physical measures must be in place to make evidence of tampering or unauthorized use immediately apparent to the GI owner/representative.
- A grease interceptor will be considered secure if it is equipped with physical barriers (such as locking covers and/or permanent fencing) that are only removable by the owner/representative utilizing a unique key or "unlocking device". Furthermore, the barrier in place will reasonably ensure that unauthorized access can only be gained by deliberate actions utilizing uncommon tools and extreme effort/force.